CR120

Optimised circular fire damper up to 120'

















Table of content

Table of content

Declaration of performance	4
Product presentation CR120	5
Range and dimensions CR120	6
Variant CR120-L500	6
Range and dimensions CR120-L500	6
Variant CR120-1S	6
Range and dimensions CR120-1S	7
Variant CR120-1S-L500	7
Range and dimensions CR120-1S-L500	8
Evolution - kits	9
Options - at the time of order	11
Storage and handling	12
Installation	12
Installation at a minimal distance from another damper or from an adjacent supporting construction	13
Installation in rigid wall	15
Installation in rigid floor	17
Installation in flexible wall (metal stud gypsum plasterboard wall)	19
Installation in flexible wall (metal stud gypsum plasterboard wall), sealing with gypsum	21
Installation in flexible wall (metal stud gypsum plasterboard wall), sealing with mortar	23
Installation in shaft wall with IFW installation kit	25
Installation in gypsum block wall	27
Installation in flexible and rigid wall, sealing with rigid rock wool boards with coating	29
Installation in rigid floor, sealing with rigid rock wool boards with coating	32
Installation remote from the wall, sealing and insulation with rigid rock wool boards with coating	34
Installation remote from the wall, sealing with mortar and insulation with rigid rock wool boards with coating	37
Installation remote from the wall + GEOFLAM	39
Installation in rigid wall with collar for surface-mount 1s Installation in flexible wall with collar for surface-mount 1s	42 43
Inspection of the damper	43 44
Operation and mechanisms	45
·	
Electrical connection	49
Weights Coloration data	51
Selection data	52
Example	52
Sample order	54
Approvals and certificates	55

Explanation of the abbreviations and pictograms

Explanation of the abbreviations and pictograms

Wn = nominal width Hn = nominal height Dn = nominal diameter

E = integrity

I = thermal insulation S = smoke leakage Pa = pascal

ve = vertical wall penetration ho = horizontal floor penetration

o -> i = meets the criteria from the outside

(o) to the inside (i)

i <-> o = fire side not important V AC = Volt alternating current V DC = Volt direct current E.TELE = power supply magnet E.ALIM = power supply motor

V = voltW = watt

Auto = automatic
Tele = remote controlled
Pnom = nominal capacity
Pmax = maximum capacity

GKB (type A) / GKF (type F): "GKB" stands for standard plasterboards (type

plasterboards offer a higher fire resistance

for a similar plate thickness (type F

A according to EN 520) while "GKF"

according to EN 520) Cal-Sil = calcium silicate

OP = option (delivered with the product) KIT = kit (delivered separately for repair or

upgrade)

PG = connection flange to the duct

Sn = free air passage

 ζ [-] = pressure loss coefficient

Q = airflow

 ΔP = static pressure drop v = air speed in the duct

Lwa = A-weighted sound power level Lw oct = sound power level per octave

midband

dB(A) = A-weighted decibel value

 $\Delta L = correction factor$

Y	higher net building volume through compact size	×	optimal acoustic performance
O AP	optimal free air passage and minimal pressure loss		minimal distance allowed
EN 1751 C	air-tightness class C according to EN1751		Hygiene certificate (www.HYG.de)
	suitable for built-in installation		suitable for installation remote from the wall
BASTA OK	sealing with fire resistant stone wool boards allowed, also for asymmetric opening	(O)	fast installation

CE_DoP_Rf-t_C11_EN = M-01/10/2023

DECLARATION OF PERFORMANCE

State between the counter cached below Engage Engag	2. Intended use/es:			Circular fire damper to be used	in conjunction with partitions to maintain fire or	ompartments in heating, ventilating and a	air conditioning i	installations.	
Fig. 2017 Fig.	3. Manufacturer:			Rf-Technologies NV, Lange Am	bachtstraat 40, B-9860 Oosterzele				
Act	4. System/s of AVCP:			System 1					
No. 1992	5. Harmonised standard / Technical Assessment B	European Assessment Document; notified bo ody, notified body; certificate of constancy of	dy / European Technical Assessment, performance:	EN 15650:2010, BCCA with ider	ntification number 0749; BCCA-0749-CPR-BC1-60	i6-0464-15650.02-2517 2822-UKCA-CPR-(20055		
	5. Declared performance	ccording to EN 15650:2010		(Fire resistance according to EN	l 1366-2 and classifications according to EN 1350	1-3)			
Package Pack	Essential characteristics							Performance	
Page	Range	Wall type	Wall		Sealing		Installation	Classification	
Note that Note No	Ø 100-315 mm	Rigid wall	Reinforced concrete ≥ 110 mm		Mortar / Gypsum		1	El 120 (v _e i ↔ o) S - (500 Pa)	
State Stat			Aerated concrete ≥ 100 mm		Gypsum		1	El 120 (v _e i ↔ o) S - (500 Pa)	
Stoke word + conting 2 toll graph Stoke word + conting 2 toll graph Continued cut and cu					Mortar		1	El 120 (v _e i ↔ o) S - (300 Pa)	
Storewood + counting 2 Holy March 2 Holy Marc					Stone wool + coating ≥ 140 kg/m³ + coated ca	sing	1	El 120 (v _e i ↔ o) S - (300 Pa)	
State Stat					Stone wool + coating ≥ 140 kg/m³		1	El 90 (v _e i ↔ o) S - (300 Pa)	
State Stat					Stone wool Mulcol Multimastic FB1 + coating		-	El 60 (v _e i ↔ o) S - (300 Pa)	
Separation Sep					Galvanised duct + stone wool + coating ≥ 140	kg/m³ 2x50 mm	2	El 90 (vei ↔ o) S - (300 Pa)	
Right floor Red accounted = 150 mm Montan					Galvanised duct + stone wool + coating ≥ 140	kg/m³ 2x50 mm + mortar	2	El 90 (v _e i ↔ o) S - (300 Pa)	
Page					Galvanised duct + GEOFLAM® F 45 mm + mort	ar	2	El 120 (v _e i ↔ o) S - (500 Pa)	
Right floor Residue doubles = 2.100 mm Mortat Acetable Concrete ≥ 150 mm Acetable Con					Galvanised duct + GEOFLAM® Light 35 mm + n	nortar	2	El 120 (v _e i ↔ o) S - (500 Pa)	
New Indicator New Indicato		Rigid floor	Reinforced concrete ≥ 150 mm		Mortar		3	El 120 (h _o i ↔ o) S - (500 Pa)	
Recibit evail			Aerated concrete ≥ 100 mm		Mortar		3	El 90 (h _o i ↔ o) S - (500 Pa)	
Prevale wall Metal studic gypsum plasterboard Type A (EN S20) ≥ 100 mm Gypsum			Aerated concrete ≥ 150 mm		Stone wool + coating ≥ 140 kg/m³ + coated ca	sing	3	El 120 (h, i ↔ o) S - (300 Pa)	
Heiche wall Metal studic gypsum plasterboard Type F (EN S20) ≥ 100 mm Storewool - coating ≥ 140 tsgm² 1 E160 ts_1 e ol S - (500 Pa)					Stone wool + coating ≥ 140 kg/m³		3	El 90 (h, i ↔ o) S - (300 Pa)	
Metal Studis gypsum plaster board Type F (EN 520) ≥ 100 mm Gypsum Acymmetrical Residue wall Encode casing End Studies		Flexible wall	Metal studs gypsum plasterboard Type	A (EN 520) > 100 mm	Gypsum		1	El 60 (v. i ⇔ o) S - (500 Pa)	
Metal studs gypsum plasterboard Type F (EN \$20) ≥ 100 mm Metal studs gypsum plasterboard Type F (EN \$20) ≥ 100 mm Metal studs gypsum plasterboard Type F (EN \$20) ≥ 100 mm Stone wood+ coating ≥ 140 kg/m² + coating ≥ 140 kg/m² > Stone wood+ coating ≥ 140 kg/m² + coating ≥ 140 kg/m² > Stone wood+ coating ≥					Stone wool + coatina ≥ 140 kg/m³			El 60 (v, i ↔ o) S - (300 Pa)	
Stone wool Challe Wall Challe Wall Challe C			Metal studs gypsum plasterboard Type	F (FN 520) > 100 mm	Gypsum		-	El 90 (v i ⇔ o) S - (500 Pa)	на
Stone wool + coating ≥ 140 kg/m² + coated casing					Mortar			El 120 (v, i ↔ o) S - (300 Pa)	rmo EN
Stone wool Huck Diffusion Stone wool St					Stone wool + coating > 140 kg/m ³ + coated ca	sing	-	El 120 (v i ⇔ o) S - (300 Pa)	
Stone wool Multical Multimastic FB1 + coating Stone wool					Stone wool + coating ≥ 140 kg/m³	n		El 90 (v _o i ↔ o) S - (300 Pa)	
Supparametrical flexible wall Markal studis gypsamm plasterboard Type F (EM 520) ≥ 90 mm Installation kills Supparametrical flexible wall Markal studis gypsamm plasterboard Type F (EM 520) ≥ 100 mm Stone wool ≥ 40 gym² + cover plates 1					Stone wool Mulcol Multimastic FB1 + coating		-	El 60 (v i ⇔ o) S - (300 Pa)	
State Paragraph Paragrap					Galvanised duct + stone wool + coating ≥ 140	kg/m³ 2x50 mm	. 2	El 90 (v _e i ↔ o) S - (300 Pa)	
Asymmetrical flexible wall (shaft wall) Midal studs gypsum plasterboard Type F (EN 520) ≥ 90 mm Stone wool ≥ 40 kg/m² + cover plates			Gvpsum blocks ≥ 70 mm		Block alue	5	-	El 120 (v, i ↔ o) S - (500 Pa)	u
Flexible wall Metal studs gypsum plasterboard Type A (EN 520) ≥ 100 mm Stone wool ≥ 40 kg/m³ + cover plates Stone wool ≥ 40 kg/m³ + cover plates 1 <td></td> <td>Asymmetrical flexible wall (shaft wall)</td> <td>Metal studs gypsum plasterboard Type</td> <td>F (EN 520) ≥ 90 mm</td> <td>Installation kit</td> <td></td> <td>4</td> <td>El 90 (v_ei ↔ o) S - (300 Pa)</td> <td></td>		Asymmetrical flexible wall (shaft wall)	Metal studs gypsum plasterboard Type	F (EN 520) ≥ 90 mm	Installation kit		4	El 90 (v _e i ↔ o) S - (300 Pa)	
Rejoid wall Acrated concrete ≥ 100 mm Acrated concrete ≥ 100 mm Indicate broad Type F (EN 520) ≥ 100 - 5.125 mm Not applicable Image: Problem of the pro	100-250 mm	Flexible wall	Metal studs gypsum plasterboard Type	. A (EN 520) ≥ 100 mm	Stone wool ≥ 40 kg/m³ + cover plates		1	El 60 (v _e i ↔ o) S - (500 Pa)	
Hexible wall Flexible wall Flexibl	R120-15Ø100-315mm	Rigid wall	Aerated concrete ≥ 100 mm		Not applicable		5	El 120 (v _e i ↔ o) S - (500 Pa)	
tances tall 45. Solid Fig. 1.		Flexible wall	Metal studs gypsum plasterboard Type	F (EN 520) ≥ 100 - ≤ 125 mm	Not applicable		5	El 120 (v _e i ↔ o) S - (500 Pa)	
tances tances distances authorised.	Type of installa 0-360°. Minima authorised witl	n,		of installation: remote from all, 0/180°. Minimal distances rised.	230 mm	Type of installation: built-in, 0-360°. Minimal distances authorised.	360°	ΦΦ	
sensitivity:); closure time lility: cording to EN 60068-2-52:		'n		of installation: surface- rted, 0/180°. Minimal rces authorised.					
3); closure time allity: cording to EN 60068-2-52:	ominal activation condit	ons/sensitivity:		Pass					
vility: conding to EN 60068-2-52:	esponse delay (response	ime): closure time		Pass	se: MMAG - 300 cvcles: BEI (T) - 10000 cvcles: ON	E - 10000 cycles: ONE-X - 10000 cycles: 110	10000 ovele	90	
	urability of response dela			Pass	es, iniivina - 500 cycles, bi E(1) - 10000 cycles, Ola	ב - וסססס כליכובי, סועב-א - וסססס כליכובי, סו	אוע - ו שטטט באבופ	a	
	urability of operational r	liability:		Pass					
	rotection against corrosic	n according to EN 60068-2-52:		Pass					

The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.



Product presentation CR120

Optimised circular fire damper with a fire resistance up to 120 minutes. A minimal pressure loss is guaranteed thanks to the thin blade, the fusible link aligned with the blade, and the transmission located outside the tunnel. The damper is available in small diameters (starting from 100 mm). Its galvanised steel tunnel contributes to the light weight of the damper.

Fire dampers are installed where air ducts penetrate fire-resistant compartment walls. Their role is to restore the fire resistance grade of the penetrated wall and to prevent smoke propagation. Fire dampers are distinguished by their degree of fire resistance, by their aeraulic properties as well as by their installation ease. Rf-Technologies' fire dampers are all CE marked. They can be equipped with various types of mechanisms depending on the specific needs linked to the project or to the local regulations.

- easy to install
- ✓ optimal free air passage and minimal pressure loss
- ☑ optimal acoustic performance
- ☑ higher net building volume through compact size
- ☑ air-tightness class C according to EN1751
- suitable for built-in installation
- suitable for installation remote from the wall
- minimal distance allowed
- suitable for rigid wall, rigid floor and light wall (metal stud gypsum plasterboard wall)
- sealing with fire resistant stone wool boards allowed, also for asymmetric opening
- tested according to EN 1366-2 up to 500 Pa
- operating mechanism outside the wall
- maintenance-free
- for indoor use
- operating temperature: max. 50°C
- Hygiene certificate (www.HYG.de)
- 1. casing in galvanised steel
- 2. damper blade
- 3. operating mechanism
- 4. rubber sealing ring
- 5. intumescent strip
- 6. positioning plate
- 7. sealing ring for damper blade
- 8. fusible link
- 9. product identification




















Range and dimensions CR120

Range and dimensions CR120

Exceeding damper blade: 20 mm for ØDn 315 mm

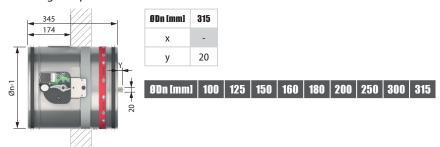


Variant CR120-L500

CR120 damper with a tunnel casing extension at the wall side to facilitate the connection to the duct when the supporting construction is thicker than 100 mm.

- 1. casing in galvanised steel
- 2. damper blade
- 3. operating mechanism
- 4. rubber sealing ring
- 5. intumescent strip
- 6. positioning plate
- 7. sealing ring for damper blade
- 8. fusible link
- 9. product identification



Range and dimensions CR120-L500

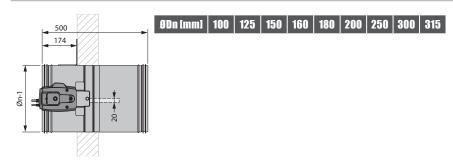

Variant CR120-1S

Surface mounted circular fire damper with a fire resistance of 120 minutes. The surface mounting ensures a fast (dry) installation. Its thin blade, the fusible link aligned with the blade, and the transmission located outside the tunnel guarantee a minimum pressure loss. The damper is available in small diameters (startingfrom 100 mm).

- ☑ no specific tools, no sealing required
- ✓ fast installation
- ☑ air-tightness class C according to EN1751






- suitable for surface-mount in rigid wall and light wall (metal stud gypsum plasterboard wall)
- not available in diameter 150, 180 and 300 mm
- minimal distance allowed

- 1. fire damper
- 2. upper mounting collar
- 3. lower mounting collar
- 4. graphite strip
- 5. sealing cold smoke
- 6. tape + graphite strip




Range and dimensions CR120-1S

Exceeding damper blade: 20 mm for ØDn 315 mm



125

ØDn immi | 100 |





Variant CR120-1S-L500

355

375

474

CR120-1S damper with a tunnel casing extension at the wall side to facilitate the connection to the duct when the supporting construction is thicker than 100 mm.

- ☑ no specific tools, no sealing required
- fast installation
- ☑ air-tightness class C according to EN1751
- suitable for surface-mount in rigid wall and light wall (metal stud gypsum plasterboard wall)
- not available in diameter 150, 180 and 300 mm
- minimal distance allowed
- 1. fire damper
- 2. upper mounting collar
- 3. lower mounting collar
- 4. graphite strip
- 5. sealing cold smoke
- 6. tape + graphite strip











Range and dimensions CR120-1S-L500





ØDn	1s	Ød	ø
100	279	160	180
125	299	180	200
160	339	220	240
200	374	255	275
250	419	300	320
315	474	355	375





	MFUS	ONE (X)	BFL(T)
P	72	80	63
Q	123	136	100
Z	70	75	58

Evolution - kits

	KIT MFUS	Automatic unlocking mechanism with fusible link
1/911	KIT ONET 24 FDCB	Spring return actuator ONE 24V (with fusible link T) + bipolar beginning- and end-of-range switch
	KIT ONET 24 FDCU	Spring return actuator ONE 24V (with fusible link T) + unipolar beginning- and end-of-range switch
	KIT ONET 24 FDCU ST	Spring return actuator ONE 24V (with fusible link T) + unipolar beginning- and end-of-range switch + plug (ST)
	KIT ONET 230 FDCB	Spring return actuator ONE 230V (with fusible link T) + bipolar beginning- and end-of-range switch
	KIT ONET 230 FDCU	Spring return actuator ONE 230V (with fusible link T) + unipolar beginning- and end-of-range switch
1/11/1	KIT ONET 230 FDCU ST	Spring return actuator ONE 230V (with fusible link T) + unipolar beginning- and end-of-range switch + plug (ST)
	KIT ONE-X 24	Spring return actuator ONE-X 24V (with fusible link T)
	KIT ONE-X 230	Spring return actuator ONE-X 230V (with fusible link T)

0	KIT BFL24	Spring return actuator BFL 24V
O L	KIT BFL24-ST	Spring return actuator BFL 24V with plug (ST)
A ST	KIT BFL230	Spring return actuator BFL 230V
2	KIT BFLT24	Spring return actuator BFL 24V with thermo-electric fuse (T)
20	KIT BFLT24-ST	Spring return actuator BFL 24V with thermo-electric fuse (T) and plug (ST)
0 0 0	KIT BFLT230	Spring return actuator BFL 230V with thermo-electric fuse (T)
	KIT BFLT230-ST	Spring return actuator BFL 230V with thermo-electric fuse (T)
	KIT BFN24	Spring return actuator BFN 24V (BFN kits must be used instead of BFL kits for fire dampers produced before 1/7/2015)
	KIT FDCU MFUS(P)	Limit switch 'open/closed'



Options - at the time of order

IFW CR120	Pre-mounted installation kit for flexible shaft wall
1\$	Collar for circular surface-mount 1s (100-315 mm)
UL	Inspection opening to visually determine the state and the position of the damper, by using an endoscope.

Storage and handling

Storage and handling

As this product is a safety element, it should be stored and handled with care.

Avoid:

- any kind of impact or damage
- contact with water
- deformation of the casing

It is recommended:


- to unload in a dry area
- not to flip or roll the product to move it
- not to use the damper as a scaffold, working table, etc.
- not to store smaller dampers inside larger ones

Installation

General points


- The installation must comply with the installation manual and the classification report.
- Axis orientation: see the declaration of performance.
- Avoid obstruction of adjoining ducts.
- Product installation: always with closed damper blade.
- Verify if the blade can move freely.
- Please observe safety distances with respect to other construction elements. The operating mechanism must also remain accessible: allow for a clearance of 200 mm around the housing.
- The air tightness class will be maintained if the damper is installed according to the installation manual.
- Rf-t fire dampers are always tested in standardised constructions according to EN 1366-2. The achieved results are valid for similar supporting constructions with a fire resistance, thickness and density equal or superior to the supporting construction used during the test.
- If the wall thickness exceeds the minimum thickness specified in our installation instructions, the following conditions apply to the sealing depth:
 - For flexible walls and sandwich panel system walls, the seal must always be applied over the full depth of the wall.
 - With rigid walls, rigid floors and plaster block walls, the minimum sealing depth as indicated in our installation instructions (often equal to the minimum wall thickness) is sufficient. Apply the seal at the height of the damper blade (from the wall limit indication).
- When installing a fire damper in a flexible metal stud wall, some installation methods do not require reinforcing profiles around the wall opening from a fire protection point of view (see below). Always follow the general instructions of the manufacturer of these wall systems when building this type of wall.
- The damper must remain accessible for inspection and maintenance.
- Schedule at least 2 visual checks each year.

(1)	Т	EST	Г	
2021	✓	1	☑	
2022				
2023				
2024				
2025				



Installation at a minimal distance from another damper or from an adjacent supporting construction

1



1. Principle

According to the European test standard, a fire damper must be installed at a minimum distance of 75 mm from an adjacent wall and 200 mm from another damper, unless the solution was tested at a shorter distance.

This range of Rf-t fire dampers has been successfully tested and can be installed in a vertical or horizontal supporting construction, at a distance below the minimum set by the standard.

For circular dampers, the minimal distance is set to 30 mm.

2




2. Certified solution

For the Rf-t fire dampers, the solution consists of the following elements: A: Universal sealing for minimal distance; B: Sealing compliant with existing classifications (Declaration of Performance).

A. Sealing of the opening at the side with minimal distances between damper and wall/ceiling or another fire damper: rigid stone wool panels (150 kg/m³) are applied to a depth of min. 400 mm, of which 150 mm on the mechanism side of the wall. On the non-mechanism side of the wall, the stone wool panels must be at least flush with the wall.

The surface of this sealing is set between the axes (centres) of the dampers.

B. Sealing of the rest of the opening according to the existing classifications for the fire damper (Declaration of Performance). This also applies to circular dampers that are mounted at a minimum distance from one another (30 to 200 mm) but at a distance greater than 75 mm from a wall/ceiling. Detailed information for each wall/sealing combination can be found in the respective installation methods.



3. Restrictions

The orientation of the blade axis should be horizontal or oriented at a maximum of 45°.

A maximum of 3 circular dampers can be installed at a minimum distance from one another, both vertically and horizontally (with a maximum cluster of 4 dampers). Note: when sealing the opening with panels of fire resistant stone wool, the maximum number of dampers also depends on the maximum "blank seal" allowed for the selected sealing material. Please refer to the manufacturer's instructions for this information.

Note: Separate conditions apply for installation in flexible shaft wall. Detailed information can be found in the relevant installation methods.


Installation in rigid wall


The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-315 mm	Rigid wall	Reinforced concrete ≥ 110 mm	Mortar / Gypsum	EI 120 (v _e i ↔ o) S - (500 Pa)
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Gypsum	EI 120 (v _e i ↔ o) S - (500 Pa)
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Mortar	El 120 (v _e i ↔ o) S - (300 Pa)

2


4






3


1





4. The dampers can be installed at a minimum distance (\geq 30 mm) from an adjacent wall or from another damper.





5. Make the necessary openings (\leq Dn + 100 mm) / (\leq Dn + 80 mm) in the wall.





6. Mount the dampers in the opening.


Apply rigid stone wool panels (≥ 150 kg/m³) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

Caution: the opening is sealed according to the existing classification (see next point) when:

- 2 fire dampers are installed at a minimum distance from one another but at a normal distance (\geq 75 mm) from the wall or floor/ceiling.
- One single (no cluster) fire damper is located at a minimum distance (≤ 75 mm) from a wall or floor/ceiling.








7. Seal the rest of the opening with standard mortar or gypsum.

Installation in rigid floor

The product was tested and approved in:


Range	Wall type		Sealing	Classification
Ø 100-315 mm	Rigid floor	Reinforced concrete ≥ 150 mm	Mortar	El 120 (h _o i ↔ o) S - (500 Pa)
Ø 100-315 mm	Rigid floor	Aerated concrete ≥ 100 mm	Mortar	El 90 (h₀ i ↔ o) S - (500 Pa)

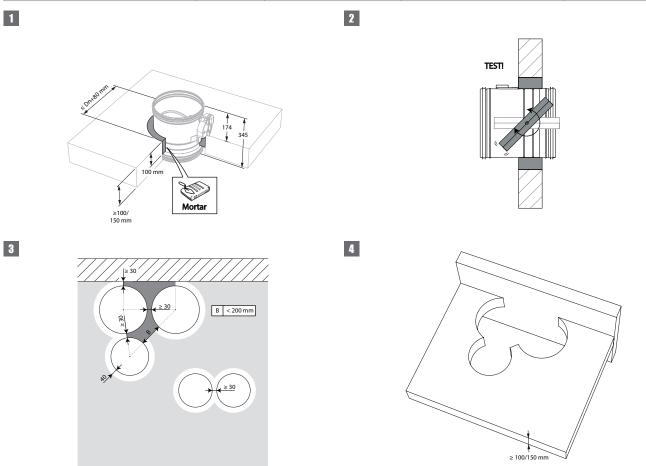

3. The dampers can be installed at a minimum distance (\geq 30 mm) from an adjacent wall or from another damper.

4. Make the necessary openings (\leq Dn + 80 mm) in the floor.





5. Mount the dampers in the opening.

Apply rigid stone wool panels (≥ 150 kg/m³) to a depth of 400 mm (150 mm on the mechanism side of the floor) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

Caution: the opening is sealed according to the existing classification (see next point) when:

- 2 fire dampers are installed at a minimum distance from one another but at a normal distance (\geq 75 mm) from the wall or floor/ceiling.
- One single (no cluster) fire damper is located at a minimum distance (≤ 75 mm) from a wall or floor/ceiling.




6. Seal the rest of the opening with standard mortar.

6

Installation in flexible wall (metal stud gypsum plasterboard wall)

The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-250 mm	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) ≥ 100 mm	Stone wool ≥ 40 kg/m³ + cover plates	El 60 (v _e i ↔ o) S - (500 Pa)

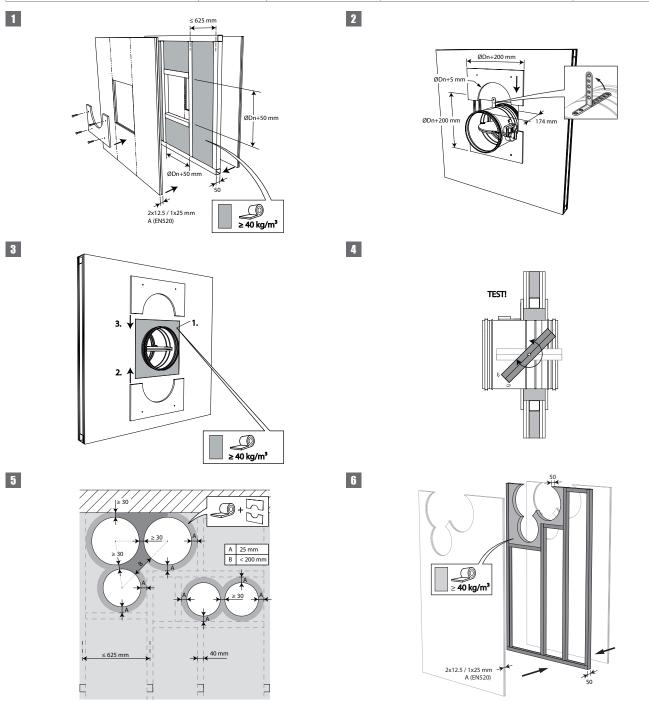

5. The dampers can be installed at a minimum distance (≥ 30 mm) from an adjacent wall or from another damper.

6. Build the drywall and foresee horizontal and vertical studs around the opening.

In the opening around the dampers (Dn + 50 mm), the void between the gypsum boards is filled with stone wool with a minimum density of 40 kg/m³.



7. Mount the dampers in the opening.


Apply rigid stone wool panels ($\geq 150 \text{ kg/m}^3$) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

Caution: the opening is sealed according to the existing classification (see next point) when:

- 2 fire dampers are installed at a minimum distance from one another but at a normal distance (\geq 75 mm) from the wall or floor/ceiling.
- One single (no cluster) fire damper is located at a minimum distance (≤ 75 mm) from a wall or floor/ceiling.

8



8. Apply cover plates (gypsum plasterboards) to finish the surface at both sides.


Seal off the space between the plasterboards with jointfiller.


Installation in flexible wall (metal stud gypsum plasterboard wall), sealing with gypsum


The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) ≥ 100 mm	Gypsum	El 60 (v _e i ↔ o) S - (500 Pa)
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Gypsum	El 90 (v _e i ↔ o) S - (500 Pa)

2







2x12.5 / 1x25 mm

2x12.5 / 1x25 mm

2x12.5 / 1x25 mm

3. The dampers can be installed at a minimum distance (\geq 30 mm) from an adjacent wall or from another damper.

4. Build the drywall and foresee horizontal and vertical studs around the opening.

In the opening around the dampers, the void between the gypsum boards is partially filled (up to Dn + 80 mm) with stone wool with a minimum density of 40 kg/m^3 .



5. Mount the dampers in the opening.


Apply rigid stone wool panels ($\geq 150 \text{ kg/m}^3$) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

Caution: the opening is sealed according to the existing classification (see next point) when:

- 2 fire dampers are installed at a minimum distance from one another but at a normal distance (\geq 75 mm) from the wall or floor/ceiling.
- One single (no cluster) fire damper is located at a minimum distance (≤ 75 mm) from a wall or floor/ceiling.

6




6. Seal the rest of the opening with standard gypsum across the entire wall thickness.


Installation in flexible wall (metal stud gypsum plasterboard wall), sealing with mortar


The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Mortar	El 120 (v _e i ↔ o) S - (300 Pa)

2







2x12.5 / 1x25 mm 50

3. The dampers can be installed at a minimum distance (≥ 30 mm) from an adjacent wall or from another damper.

4. Build the drywall and foresee horizontal and vertical studs around the opening.

For a circular wall opening, the space between the plasterboard sheets is partially (up to Dn + 40 mm) filled with stone wool with a minimum density of 40kg/m^3 .



5. Mount the dampers in the opening.


Apply rigid stone wool panels (≥ 150 kg/m³) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

Caution: the opening is sealed according to the existing classification (see next point) when:

- 2 fire dampers are installed at a minimum distance from one another but at a normal distance (≥ 75 mm) from the wall or floor/ceiling.
- One single (no cluster) fire damper is located at a minimum distance (≤ 75 mm) from a wall or floor/ceiling.

6



6. Seal the rest of the opening with standard mortar across the entire wall thickness.


Installation in shaft wall with IFW installation kit

The product was tested and approved in:


Range	Wall type		Sealing	Classification
Ø 100-315 mm	,	Metal studs gypsum plasterboard Type F (EN 520) ≥ 90 mm	Installation kit IFW	El 90 (v _e i ↔ o) S - (300 Pa)

4


6



1. Depending on the shaft wall system, the cladding is 15 or



2. Alternatively, the aperture framing can also be stepped.





20mm thick.

5





5. The fire damper may be placed at minimum distance from the ceiling/floor slab.






6. Alternatively, the aperture framing can also be stepped.






8




9. The fire dampers may be placed at minimum distance from each other and from the ceiling/floor slab.

Installation in gypsum block wall

The product was tested and approved in:

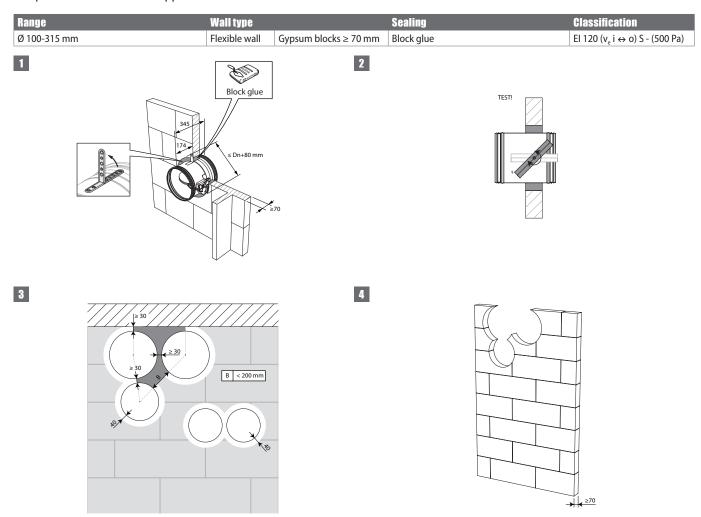

3. The dampers can be installed at a minimum distance from an 4. Make the necessary openings (\leq Dn + 80 mm) in the wall. adjacent wall or from another damper.



5. Mount the dampers in the opening.


Apply rigid stone wool panels (≥ 150 kg/m³) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

Caution: the opening is sealed according to the existing classification (see next point) when:

- 2 fire dampers are installed at a minimum distance from one another but at a normal distance (\geq 75 mm) from the wall or floor/ceiling.
- One single (no cluster) fire damper is located at a minimum distance (≤ 75 mm) from a wall or floor/ceiling.

6



6. Seal the rest of the opening with block glue across the entire wall thickness.

Installation in flexible and rigid wall, sealing with rigid rock wool boards with coating

The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Stone wool + coating ≥ 140 kg/m ³ + coated casing	El 120 (v _e i ↔ o) S - (300 Pa)
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Stone wool + coating ≥ 140 kg/m ³	El 90 (v _e i ↔ o) S - (300 Pa)
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) ≥ 100 mm	Stone wool + coating ≥ 140 kg/m ³	El 60 (v _e i ↔ o) S - (300 Pa)
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Stone wool + coating ≥ 140 kg/m ³ + coated casing	El 120 (v _e i ↔ o) S - (300 Pa)
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Stone wool + coating ≥ 140 kg/m ³	El 90 (v _e i ↔ o) S - (300 Pa)
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Stone wool Mulcol Multimastic FB1 + coating	El 60 (v _e i ↔ o) S - (300 Pa)
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Stone wool Mulcol Multimastic FB1 + coating	El 60 (v _e i ↔ o) S - (300 Pa)

2

4


A (EN520)
F (EN520)
100 mm

3 Dn + 600

MULCOL MULTIMASTIC SP
PROMASTOP-E / CC
/ HILLI CES-S ACR
PYRO-SAFE* FLAMMOTECT-A


MULCOL MULTIMASTIC FB1
// HILLI CES-CT B / PYRO-SAFE* MFP


2. The opening around the damper is sealed with 2 layers of 50 mm-thick mineral wool panels with fire resistant coating on one side (type PROMASTOP-CB 50 / PROMASTOP-CB/CC 50 / HILTI CFS-CT B / Mulcol Multimastic FB1 / PYRO-SAFE® MFP).



3. The joints on these 2 layers must be installed staggered and covered all around the edge with coating (type PROMASTOP-E / PROMASTOP-CC / HILTI CFS-S-ACR / Mulcol Multimastic SP / PYRO-SAFE® FLAMMOTECT-A).









8

5. For EI 120 S, the casing of the fire damper must be covered with a layer (> 1 mm) of coating (type PROMASTOP E / PROMASTOP CC / HILTI CFS-CT / PYRO-SAFE® FLAMMOTECT-A).

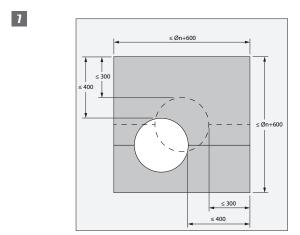



7. The damper does not need to be centered in the opening (with max dimensions fire damper + 600 mm). The maximal distance between the damper and the edge of the opening is 400 mm.

9



8. The dampers can be installed at a minimum distance (\geq 30 mm) from an adjacent wall or from another damper.





10. Build the drywall and foresee horizontal and vertical studs around the opening.

Mount the dampers in the opening.




11. Apply rigid stone wool panels (\geq 150 kg/m³) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

Caution: the opening is sealed according to the existing classification (see next point) when:


- 2 fire dampers are installed at a minimum distance from one another but at a normal distance (\geq 75 mm) from the wall or floor/ceiling.
- One single (no cluster) fire damper is located at a minimum distance (≤ 75 mm) from a wall or floor/ceiling.

12



12. Seal the rest of the opening with 2 layers of 50 mm-thick coated rigid mineral wool panels (see above).

13




Installation in rigid floor, sealing with rigid rock wool boards with coating


The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-315 mm	Rigid floor	Aerated concrete ≥ 150 mm	Stone wool + coating ≥ 140 kg/m ³ + coated casing	EI 120 (h₀ i ↔ o) S - (300 Pa)
Ø 100-315 mm	Rigid floor	Aerated concrete ≥ 150 mm	Stone wool + coating ≥ 140 kg/m ³	El 90 (h₀ i ↔ o) S - (300 Pa)

1




2




1. The opening around the damper is sealed with 2 layers of 50 mm-thick mineral wool panels with fire resistant coating on one side (type PROMASTOP-CB 50 / PROMASTOP-CB/CC 50 / HILTI CFS-CT B).

3








3. The joints on these 2 layers must be installed staggered and covered all around the edge with coating (type PROMASTOP-E / PROMASTOP-CC / HILTI CFS-S-ACR).


TEST!





5. For El 120 S, the casing of the fire damper must be covered with a layer (> 1 mm) of coating (type PROMASTOP E / PROMASTOP CC / HILTI CFS-CT).






7. The damper does not need to be centered in the opening (with max dimensions fire damper + 600 mm). The maximal distance between the damper and the edge of the opening is 400 mm.


8

6



8. The dampers can be installed at a minimum distance (\geq 30 mm) from an adjacent wall or from another damper.






9. For details, please refer to 'Installation in flexible and rigid wall, sealing with rigid rock wool boards with coating'

Installation remote from the wall, sealing and insulation with rigid rock wool boards with coating

The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Galvanised duct + stone wool + coating ≥ 140 kg/m³ 2x50 mm	El 90 (v _e i ↔ o) S - (300 Pa)
Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Galvanised duct + stone wool + coating ≥ 140 kg/m³ 2x50 mm	El 90 (v _e i ↔ o) S - (300 Pa)

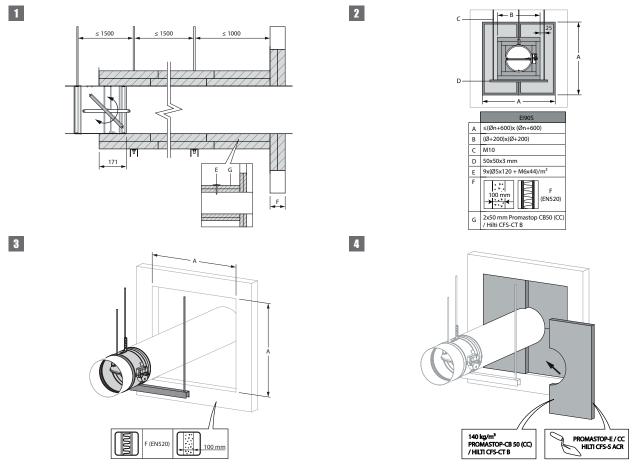


3. An opening with maximal dimensions "A" is made in the wall. For a light partition wall, follow the wall assembly under "Installation in flexible or rigid wall - Sealing with fire resistant rigid panels of stone wool".

The fire damper is mounted remote from the wall at the end of a metal duct. The fire damper is supported by a clamping ring of the same diameter as the damper, held in place by threaded rods "C". The duct is supported every 1500 mm.

The suspensions consist of threaded rods "C" and U-shaped steel profiles "D". A free space of maximum 25 mm is left between the threaded rods and the vertical walls of the stone wool casing "B".

4. The opening around the duct is sealed with stone wool plates type Promastop CB(/CC) / Hilti CFS-CT B ("G"). The edges are sealed and maintained in place with PROMASTOP E / PROMASTOP CC / HILTI CFS-S ACR coating.




5. The duct is covered over its entire length with stone wool plates "G". To adhere to the duct, the plates are completely coated on one side with fire resitant coating and affixed to the duct with steel screws and washers "E".

The damper casing is covered with stone wool plates "G" for 171 mm. A free space should be left around the mechanism to guarantee access.

An additional stone wool panel type "G", coated with PROMASTOP E / PROMASTOP CC / HILTI CFS-S ACR, is applied in the opening between the damper casing and the stone wool panels.

6




6. The joints between the plates, between the wall and the plates as well as the screws and washers are filled with coating PROMASTOP E / PROMASTOP CC / HILTI CFS-S ACR.


7





8




8. The dampers can be installed at a minimum distance from an adjacent wall/floor or from another damper.

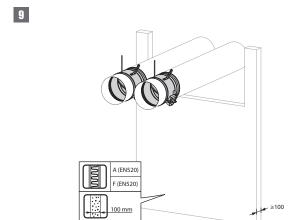








Installation remote from the wall, sealing with mortar and insulation with rigid rock wool boards with coating

The product was tested and approved in:

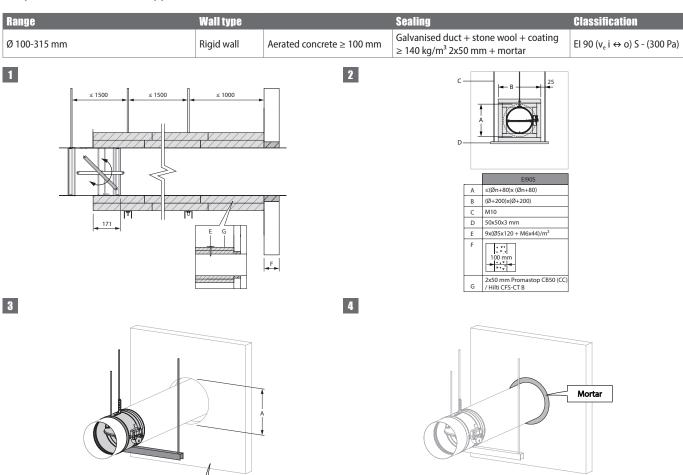


3. An opening with maximal dimensions "A" is made in the wall. The fire damper is mounted remote from the wall at the end of a metal duct. The fire damper is supported by a clamping ring of the same diameter as the damper, held in place by threaded rods "C". The duct is supported every 1500 mm.

100 mm

The suspensions consist of threaded rods "C" and U-shaped steel profiles "D". A free space of maximum 25 mm is left between the threaded rods and the vertical walls of the stone wool casing "B".

4. The opening around the duct is sealed with standard mortar.

5



5. The duct is covered over its entire length with stone wool plates "G". To adhere to the duct, the plates are completely coated on one side with fire resitant coating and affixed to the duct with steel screws and washers "E".

The damper casing is covered with stone wool plates "G" for 171 mm. A free space should be left around the mechanism to guarantee access.

An additional stone wool panel type "G", coated with PROMASTOP E / PROMASTOP CC / HILTI CFS-S ACR, is applied in the opening between the damper casing and the stone wool panels.


7



7. The dampers can be installed at a minimum distance from an adjacent wall/floor or from another damper.

Follow the instructions under "Installation remote from the wall, sealing and insulation with rigid rock wool boards with coating".

The opening around the duct to be sealed with standard mortar.



6

6. The joints between the plates, between the wall and the plates as well as the screws and washers are filled with coating PROMASTOP E / PROMASTOP CC / HILTI CFS-S ACR.


Installation remote from the wall + GEOFLAM


The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Galvanised duct + GEOFLAM® F 45 mm + mortar	EI 120 (v _e i ↔ o) S - (500 Pa)
Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Galvanised duct + GEOFLAM® Light 35 mm + mortar	El 120 (v _e i ↔ o) S - (500 Pa)


2


4






3






- 3. An opening with maximal dimensions "A" is made in the wall.
- 4. The fire damper is mounted remote from the wall at the end of a metal duct. The duct is supported every 1000 mm. The suspensions consist of threaded rods "C" and U-shaped steel profiles "D". A free space of maximum 25 mm is left between the threaded rods and the vertical walls of the casing "B".

5



6




5. The opening around the duct is sealed with standard mortar. The duct is covered with 45 mm thick GEOFLAM F plates or 35 mm thick GEOFLAM Light plates "G".

The plates adhere to each other with glue and fibrous plaster "E". The damper casing is also covered on a length of 171 mm.

6. The GEOFLAM F / GEOFLAM Light plates stop at a distance of 20 mm from the wall. The free space is filled with fibrous plaster.

The same filling is applied to seal off the connection between the GEOFLAM F plates and the damper casing.

7




8




7. The threaded rods are covered with U-shaped plates of GEOFLAM (Ø 90 mm) and affixed with glue and fibrous plaster. The profiles are covered with U-shaped shells GEOFLAM 100 x 60 mm, which are affixed to the underside of the shaft with GEOCOL (GEOSTAFF) cement plaster.

9




10




9. The dampers can be installed at a minimum distance from an adjacent wall or from another damper.






11. Apply rigid stone wool panels (150 kg/m³) to a depth of 250 mm (wall thickness + additional at the rear side of the wall) to seal the opening at the side with minimal distances.




13




14

12



14. Apply rigid stone wool panels (150 kg/m³) to a depth of 150 mm to seal the opening at the side with minimal distances.





Installation

Installation in rigid wall with collar for surface-mount 1s


The product was tested and approved in:

Range	Wall type		Sealing	Classification
CR120-1S Ø 100-315 mm	Rigid wall	Aerated concrete ≥ 100 mm	Not applicable	EI 120 (v _e i ↔ o) S - (500 Pa)


1

ØDn	1s	Ød	ø
100	279	160	180
125	299	180	200
160	339	220	240
200	374	255	275
250	419	300	320
315	474	355	375


2




3



4



5




5. The dampers can be installed at a minimum distance from an adjacent wall or from another damper.

Installation in flexible wall with collar for surface-mount 1s

The product was tested and approved in:

Range	Wall type		Sealing	Classification	
CR120-1S Ø 100-315 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) \geq 100 - \leq 125 mm	Not applicable	El 120 (v _e i ↔ o) S - (500 Pa)	

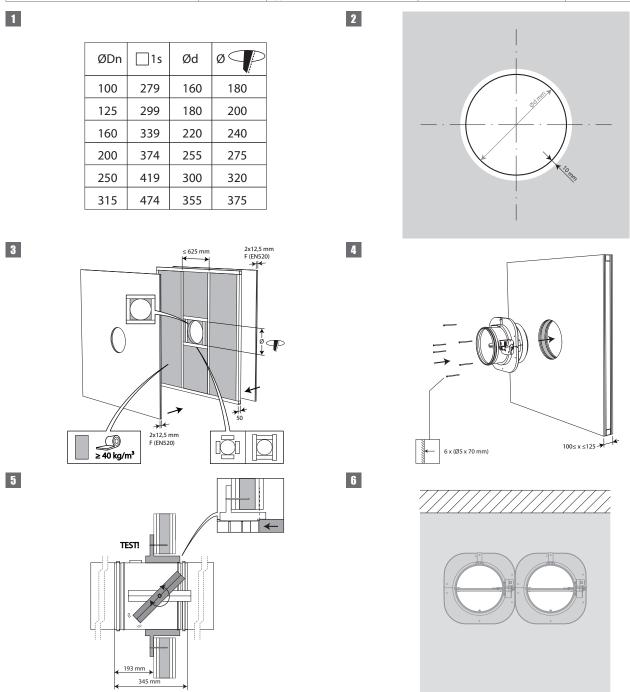


6. The dampers can be installed at a minimum distance from an adjacent wall or from another damper.


Installation

Inspection of the damper






1. Remove the air-tight plug from the damper.



2. Insert the camera of the endoscope (for example Inspecam Rf-t) through the opening and inspect the inside of the damper.





3. After inspection, replace the air-tight plug thoroughly on the damper opening. The position is crucial in order to maintain the air-tightness of the fire damper.

Maintenance

- No specific maintenance required.
- Schedule at least 2 visual checks each year.
- Remove dust and all other particles before use.
- Follow local maintenance regulations (i.e. BS9999 Annex V; NF S 61-933) and EN13306.
- Read the maintenance instructions on our website: https://www.rft.eu/assets//PIM/DOCUMENTS/BROCHURE%20KITS/BRO_K139_MAINTENANCE_C.pdf
- Use the damper at up to 95% humidity, non-condensing.
- The fire damper can be cleaned with a dry or slightly damp cloth. It is forbidden to use abrasive cleaners or mechanical cleaning techniques (brush).

Operation and mechanisms



MFUS(P) Mechanism with fusible link

The operating mechanism MFUS(P) automatically unlocks the blade when the temperature in the duct exceeds 72°C. The damper can also be unlocked and reset manually.

- 1. unlocking button
- 2. resetting handle
- 3. cable entrance



Options - at the time of order

FDCU

Limit switch 'open/closed'

Unlocking

- manual unlocking: press the unlocking button (1).
- **automatic unlocking**: the fusible link melts when the temperature reaches 72°C in the duct.
- remote unlocking: n/a

Resetting

- manual resetting: turn the resetting handle (2) 90° clockwise (or use a 10 mm hex key).
- motorised resetting: n/a

Caution:



▲ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.

Operation and mechanisms



ONE Spring return actuator for remote control

The spring-return actuator ONE is designed to easily operate Rf-t fire dampers of all sizes, automatically or remotely. Six models are available, 24 or 230 volt, with FDCU or FDCB position switches; and optionally with plug (ST).

- 1. unlocking button
- 2. blade position indicator
- 3. LED
- 4. battery compartment to reset motor



Unlocking

- **manual unlocking**: shortly press the unlocking button (1) once.
- automatic unlocking: the fusible link reacts as soon as the temperature in the duct reaches 72°C.
- **remote unlocking**: by interrupting the power supply.

Resetting

- manual resetting: open the battery compartment (4) and press a 9V battery against the contact springs. Hold this position until the LED (3) emits a continuous light. Check whether the indicator (2) shows that the damper blade is in the open position. Remove the battery, the LED fades away. Close the battery compartment.
- motorised resetting: switch off the power supply for at least 5 sec. Power the actuator (respect the prescribed voltage) for at least 75 sec. The resetting stops automatically when the end of range is reached (damper open).

Caution

- ▲ If the LED (3) flickers fast (3x/sec.), the battery is discharged: use a new battery.
- ▲ If the LED (3) flickers slowly (1x/sec), the resetting is in progress.
- A If the LED (3) is continuously on, the resetting is complete and the motor is powered.
- ▲ If the actuator detects voltage on the power cable, a brief contact of the battery is enough to start the resetting process.
- ▲ The power supply of this actuator cannot be individually replaced. If the cable is damaged, the whole unit must be discarded and replaced.
- ▲ The housing of the mechanism contains a temperature sensor. When the temperature in the housing exceeds 72°C, the mechanism unlocks. The LED flashes twice per second. When the temperature drops below 72°C, the mechanism can only be reset in a motorised manner after a manual reset (with a battery).
- ▲ The end of range switches need 1 second after operation to adopt a stable position.
- A Make sure the thermal trigger device is present in the actuator. The actuator might not function properly if this is not the case.

		prod. <	1/7/2015		prod. ≥ 1/7/2015			
	CR60(1s)	CU-LT	CR2≤400	CR2>400	CR60(1s)	CU-LT	CR2≤400	CR2>400
	CR120	CU-LT-1s	CU2≤1200	CU2>1200	CR120(1s)	CU-LT-1s	CU2≤1200	CU2>1200
Kit ONE	• • •				•	•	•	•



ONE-X Spring return actuator with integrated communication module.

The ONE-X is a spring return actuator with integrated communication module designed to simply operate Rf-t fire dampers of all sizes, automatically or remotely. The ONE-X is available in two versions: 24 V and 230 V.

- 1. unlocking button
- 2. blade position indicator
- 3. LED red: status
- 4. battery compartment
- 5. LED blue: communication
- 6. LED orange: error message
- 7. supply
- 8. bus cable



Unlocking

- **manual unlocking**: shortly press the unlocking button (1) once.
- automatic unlocking: the fusible link reacts as soon as the temperature in the duct reaches 72°C.
- remote unlocking: via ZENiX controller

Resetting

- manual resetting: Open the battery compartment (4) and press a 9V battery against the contact springs. Hold this position until the red LED (3) emits a continuous light. Control whether the indicator (2) indicates that the damper blade is open. Remove the battery. Close the battery compartment.
- **motorised resetting**: via ZENiX controller. By applying voltage during first use.

Caution:

- ▲ If the ONE-X detects voltage on the power cable, a brief contact of the battery is enough to start the resetting process, provided the ZENiX controller has sent the damper to open position or the ONE-X is being operated for the first time.
- ▲ The power supply of this actuator cannot be individually replaced. If the cable is damaged, the whole unit must be discarded and replaced.
- ▲ The housing of the mechanism contains a temperature sensor. When the temperature in the housing exceeds 72°C, the mechanism unlocks. The LED flashes twice per second. When the temperature drops below 72°C, the mechanism can only be reset in a motorised manner after a manual reset (with a battery).
- ▲ The end of range switches need 1 second after operation to adopt a stable position.

Safety regulations:

- ▲ Do not use the ONE-X for any application other than the specified applications, in particular not in aircraft or other airborne vehicles.
- ▲ The company that purchases and/or installs the ONE-X is fully responsible for the correct operation of the entire system. Only authorised specialists may perform the installation. All rules and regulations, including statutory regulations, must be observed during installation.
- ▲ This device contains electrical or electronic components and must not be disposed of as household waste. All locally applicable regulations and requirements must be strictly observed.

Operation and mechanisms



BFL(T) Remotely controlled spring return actuator

The spring return actuator BFL(T) is especially designed to operate fire dampers remotely. The BFL(T) variant is intended for fire dampers with smaller dimensions (CR60, CR120, CR2 with $\emptyset \le 400$ mm, CRS60 with $\emptyset \le 315$ mm, CU2 / CU2-15 / CU4 with B+H ≤ 1200 mm or for CU-LT and CU-LT-1s). For Markage FD with H = 200 mm or H = 2200 mm (in combination with BFT motor).

- 1. locking button
- 2. plug (ST)
- 3. access for manual resetting
- 4. thermo-electric tripping device (T)



Options - at the time of order

SN2 BFL/BFN

Auxiliary limit switch 'open/closed'

Unlocking

- manual unlocking: place the locking button on "unlock". (In case of BFLT: the damper can alternatively be unlocked by pushing the "test" button on the thermo-electric fuse)
- automatic unlocking: the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFLT).
- **remote unlocking**: by interrupting the power supply.

Caution:

▲ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.

Resetting

- manual resetting: turn the enclosed handle anti-clockwise. To block the motor, place the locking button on "lock"
- motorised resetting: switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) it takes about 60 seconds to reset the damper or when the power supply is interrupted.

Caution:


▲ Do not use a drill or powered screwdriver.

▲ Stop as soon as the motor is completely rearmed (end of range).

		prod. <	1/7/2015		prod. ≥ 1/7/2015				
	CR60(1s)	CU-LT	CR2≤400	CR2>400	CR60(1s)	CU-LT	CR2≤400	CR2>400	
	CR120	CU-LT-1s	CU2≤1200	CU2>1200	CR120 (1s)	CU-LT-1s	CU2≤1200	CU2>1200	
Kit BFL					•	•	•		
Kit BFN	•	•	•					•	
Kit BF				•					

Electrical connection







DC: Switch open position fire damper **FC:** Switch closed position fire damper

FC DC 2 3 5 6 black 2 5 6 red white + 24VDC red orange grey pink Τ \sim 24VAC L 230VAC

DC: Switch open position fire damper **FC**: Switch closed position fire damper

ONE-)





MEC	Nominal voltage motor	Nominal voltage magnet	Power consumption (stand-by)	Power consumption (operating)	Standard switches	Resetting time motor
MFUS	N/A	N/A	N/A	N/A	1mA1A, DC 5VAC 48V	N/A
ONE T 24 FDCU ST	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA1A 60V	< 75 s (cabled) / <85 s (battery)
ONE T 24 FDCU	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA1A 60V	< 75 s (cabled) / <85 s (battery)
ONE T 230 FDCU ST	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA100mA 230V	< 75 s (cabled) / <85 s (battery)
ONE T 230 FDCU	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA100mA 230V	< 75 s (cabled) / <85 s (battery)
ONE T 24 FDCB	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA1A 60V	< 75 s (cabled) / <85 s (battery)
ONE T 230 FDCB	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA1A 60V	< 75 s (cabled) / <85 s (battery)
ONE-X 24	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W		< 75 s (cabled) / <85 s (battery)
ONE-X 230	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W		< 75 s (cabled) / <85 s (battery)
BFL24	24 V AC/DC	N/A	0,7 W	2,5 W	1mA3A, AC 250V	< 60 s
BFL24-ST	24 V AC/DC	N/A	0,7 W	2,5 W	1mA3A, AC 250V	< 60 s
BFL230	230 V AC	N/A	0,9 W	3 W	1mA3A, AC 250V	< 60 s
BFLT24	24 V AC/DC	N/A	0,8 W	2,5 W	1mA3A, AC 250V	< 60 s
BFLT24-ST	24 V AC/DC	N/A	0,8 W	2,5 W	1mA3A, AC 250V	< 60 s
BFLT230	230 V AC	N/A	1,1 W	3,5 W	1mA3A, AC 250V	< 60 s
BFLT230-ST	230 V AC	N/A	1,1 W	3,5 W	1mA3A, AC 250V	< 60 s

MEC	Running time spring	Noise level motor	Noise level spring	Cable supply / control	Cable auxiliary switch	Protection class
MFUS	1 s	N/A	N/A			IP 42
ONE T 24 FDCU ST	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE T 24 FDCU	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	alogen-free) 1 m, 6 x 0.75 mm ² (halogen-free)	
ONE T 230 FDCU ST	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONET 230 FDCU	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE T 24 FDCB	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	(2x) 1 m, 6 x 0,75 mm ² (halogen-free)	IP 54
ONE T 230 FDCB	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	(2x) 1 m, 6 x 0,75 mm ² (halogen-free)	IP 54
ONE-X 24	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	bus cable: (2x) 1 m, 4 x 0,75 mm ² (halogen-free)	IP 54
ONE-X 230	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	bus cable: (2x) 1 m, 4 x 0,75 mm ² (halogen-free)	IP 54
BFL24	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFL24-ST	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFL230	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFLT24	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFLT24-ST	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free) 1 m, 6 x 0.75 mm ² (halogen-free)		IP 54
BFLT230	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	5 mm² (halogen-free) 1 m, 6 x 0.75 mm² (halogen-free)	
BFLT230-ST	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54

CR1	חרו	 B A	10

1	ØDn (mm)	100	125	150	160	180	200	250	300	315	
	kg	1,6	1,8	2,0	2,1	2,5	2,6	3,3	4,1	4,2	

CR120 + ONE

ØDn [mm]	100	125	150	160	180	200	250	300	315	
kg	2,8	3,0	3,2	3,3	3,7	3,8	4,5	5,3	5,4	

CR120 + BFL

ØDn [mm]	100	125	150	160	180	200	250	300	315	
kg	2,3	2,5	2,7	2,8	3,2	3,3	4,0	4,8	4,9	

CR120 + BFLT

ØDn [mm]	100	125	150	160	180	200	250	300	315	
kg	2,4	2,6	2,8	2,9	3,3	3,4	4,1	4,9	5,0	

CR120-L500 + MFUS

ØDn [mm]	100	125	150	160	180	200	250	300	315	
kg	1,9	2,3	2,6	2,7	3,2	3,4	4,2	5,3	5,4	

CR120-L500 + ONE

ØDn (mm)	100	125	150	160	180	200	250	300	315	
kg	3,1	3,5	3,8	3,9	4,4	4,6	5,4	6,5	6,6	

CR120-L500 + BFL

ØDn [mm]	100	125	150	160	180	200	250	300	315	
kg	2,6	3,0	3,3	3,4	3,9	4,1	4,9	6,0	6,1	

CR120-L500 + BFLT

ØDn [mm]	100	125	150	160	180	200	250	300	315	
kg	2,7	3,1	3,4	3,5	4,0	4,2	5,0	6,1	6,2	

CR120-1S + MFUS

ØDn [mm]	100	125	160	200	250	315		
kg	6,1	6,9	8,3	9,9	11,4	12,7		

CR120-1S + ONE

ØDn [mm]	100	125	160	200	250	315		
kg	7,3	8,1	9,5	11,1	12,6	13,9		

CR120-1S + BFL

ØDn (mm)	100	125	160	200	250	315		
kg	6,8	7,6	9,0	10,6	12,1	13,4		

Selection data

CR120-1S + BFLT

ØDn [mm]	100	125	160	200	250	315		
kg	6,9	7,7	9,1	10,7	12,2	13,5		

CR120-1S-L500 + MFUS

ØDn [mm]	100	125	160	200	250	315		
kg	6,3	7,2	9,1	10,5	12,1	13,6		

CR120-1S-L500 + ONE

ØDn [mm]	100	125	160	200	250	315		
kg	7,5	8,4	10,3	11,7	13,3	14,8		

CR120-1S-L500 + BFL

ØDn [mm]	100	125	160	200	250	315		
kg	7,0	7,9	9,8	11,2	12,8	14,3		

CR120-1S-L500 + BFLT

ØDn [mm]	100	125	160	200	250	315		
kg	7,1	8,0	9,9	11,3	12,9	14,4		

Selection data

$\Delta p [Pa] = \zeta^* v^2 * 0.6$

ØDn (mm)	100	125	150	160	180	200	250	300	315	
ζ [-]	0,87	0,73	0,6	0,56	0,48	0,42	0,29	0,19	0,18	

Example

Data

Dn = 250 mm, v = 5 m/s

Calculation

 $\Delta p = 0.29 * (5 m/s)^2 * 0.6 = 4.35 Pa$

CR120 - A-weighted sound power level Lwa in the room

ØDn [mm]	100	125	150	160	180	200	250	300	315	
Sn [m²]	0,0047	0,0082	0,0128	0,0148	0,0195	0,0248	0,0407	0,0605	0,0672	
Sn [%]	59,82	67,14	72,22	73,84	76,57	78,79	82,85	85,61	86,27	
$Q [m^3/h]$	234,00	356,00	503,00	568,00	711,00	868,00	1.327,00	1.878,00	2.060,00	45 dB
Δp [Pa]	36,15	28,59	22,34	20,73	17,27	14,78	9,69	6,33	5,69	4J UD
$Q [m^3/h]$	180,00	275,00	388,00	438,00	548,00	670,00	1.024,00	1.448,00	1.589,00	40 dB
Δp [Pa]	21,51	17,01	13,29	12,34	10,27	8,79	5,77	3,77	3,39	40 UD
Q [m ³ /h]	139,00	212,00	299,00	338,00	423,00	517,00	790,00	1.117,00	1.226,00	35 dB
Δp [Pa]	12,80	10,12	7,91	7,34	6,11	5,23	3,43	2,24	2,01	OJ UD
Q [m ³ /h]	107,00	164,00	231,00	261,00	326,00	398,00	609,00	862,00	946,00	30 dB
Δp [Pa]	7,62	6,02	4,71	4,37	3,64	3,11	2,04	1,33	1,20	JUUD
Q [m³/h]	83,00	126,00	178,00	201,00	252,00	307,00	470,00	665,00	729,00	25 dB
Δp [Pa]	4,53	3,58	2,80	2,60	2,16	1,85	1,21	0,79	0,71	ZJ UD

Every air flow lower than the above mentioned maximum value, will meet the listed A-weighted sound power level for the respective dimension. More information on sound power can be found in the product information on our website (documents).

CR120-L500 - A-weighted sound power level Lwa in the room

ØDn [mm]	100	125	150	160	180	200	250	300	315	
Sn [m²]	0,0047	0,0082	0,0128	0,0148	0,0195	0,0248	0,0407	0,0605	0,0672	
Sn [%]	59,82	67,14	72,22	73,84	76,57	78,79	82,85	85,61	86,27	
Q [m ³ /h]	234,00	356,00	503,00	568,00	711,00	868,00	1.327,00	1.878,00	2.060,00	45 dB
Δp [Pa]	36,15	28,59	22,34	20,73	17,27	14,78	9,69	6,33	5,69	40 UD
Q [m ³ /h]	180,00	275,00	388,00	438,00	548,00	670,00	1.024,00	1.448,00	1.589,00	40 dB
Δp [Pa]	21,51	17,01	13,29	12,34	10,27	8,79	5,77	3,77	3,39	40 UD
Q [m ³ /h]	139,00	212,00	299,00	338,00	423,00	517,00	790,00	1.117,00	1.226,00	35 dB
Δp [Pa]	12,80	10,12	7,91	7,34	6,11	5,23	3,43	2,24	2,01	OJ UD
Q [m³/h]	107,00	164,00	231,00	261,00	326,00	398,00	609,00	862,00	946,00	30 dB
Δp [Pa]	7,62	6,02	4,71	4,37	3,64	3,11	2,04	1,33	1,20	JUUD
Q [m ³ /h]	83,00	126,00	178,00	201,00	252,00	307,00	470,00	665,00	729,00	25 dB
Δp [Pa]	4,53	3,58	2,80	2,60	2,16	1,85	1,21	0,79	0,71	ZJUD

Every air flow lower than the above mentioned maximum value, will meet the listed A-weighted sound power level for the respective dimension. More information on sound power can be found in the product information on our website (documents).

CR120-1S - A-weighted sound power level Lwa in the room

ØDn [mm]	100	125	160	200	250	315	
Sn [m²]	0,0047	0,0082	0,0148	0,0248	0,0407	0,0672	
Sn [%]	59,82	67,14	73,84	78,79	82,85	86,27	
Q [m ³ /h]	234,00	356,00	568,00	868,00	1.327,00	2.060,00	
Δp [Pa]	36,15	28,59	20,73	14,78	9,69	5,69	
Q [m ³ /h]	180,00	275,00	438,00	670,00	1.024,00	1.589,00	
Δp [Pa]	21,51	17,01	12,34	8,79	5,77	3,39	
$Q [m^3/h]$	139,00	212,00	338,00	517,00	790,00	1.226,00	
Δp [Pa]	12,80	10,12	7,34	5,23	3,43	2,01	
$Q [m^3/h]$	107,00	164,00	261,00	398,00	609,00	946,00	
Δp [Pa]	7,62	6,02	4,37	3,11	2,04	1,20	
$Q [m^3/h]$	83,00	126,00	201,00	307,00	470,00	729,00	
Δp [Pa]	4,53	3,58	2,60	1,85	1,21	0,71	

Every air flow lower than the above mentioned maximum value, will meet the listed A-weighted sound power level for the respective dimension. More information on sound power can be found in the product information on our website (documents).

CR120-1S-L500 - A-weighted sound power level Lwa in the room

ØDn [mm]	100	125	160	200	250	315
Sn [m²]	0,0047	0,0082	0,0148	0,0248	0,0407	0,0672
Sn [%]	59,82	67,14	73,84	78,79	82,85	86,27
Q [m ³ /h]	234,00	356,00	568,00	868,00	1.327,00	2.060,00
Δp [Pa]	36,15	28,59	20,73	14,78	9,69	5,69
Q [m ³ /h]	180,00	275,00	438,00	670,00	1.024,00	1.589,00
Δp [Pa]	21,51	17,01	12,34	8,79	5,77	3,39
Q [m ³ /h]	139,00	212,00	338,00	517,00	790,00	1.226,00
Δp [Pa]	12,80	10,12	7,34	5,23	3,43	2,01
Q [m ³ /h]	107,00	164,00	261,00	398,00	609,00	946,00
Δp [Pa]	7,62	6,02	4,37	3,11	2,04	1,20
Q [m ³ /h]	83,00	126,00	201,00	307,00	470,00	729,00
Δp [Pa]	4,53	3,58	2,60	1,85	1,21	0,71

Every air flow lower than the above mentioned maximum value, will meet the listed A-weighted sound power level for the respective dimension. More information on sound power can be found in the product information on our website (documents).

Sample order



- 1. product
- 2. diameter
- 3. mechanism type
- 4. option: unipolar end of range switch

Approvals and certificates

All our dampers are submitted to a number of tests by official test institutes. Reports of these tests form the basis for the approvals of our dampers.



The NF-label guarantees: conformity with the standard NF S 61-937 Parts 1 and 5: "Systèmes de Sécurité Incendie Dispositifs Actionnés de Sécurité"; conformity with the national decree of March 22, 2004, changed on 14 March 2011 for the classification of fire resistance; the values of the characteristics mentioned in this document. Organisme Certificateur: AFNOR Certification, 11 Rue Francis de Pressensé, F93571 La Plaine Saint-Denis Cedex; Website: http://www.afnor.org http://www.marque-nf.com; Phone: +33 (0)1.41.62.80.00, Fax: +33 (0)1.49.17.90.00, Email: certification@afnor.org